

Available finish:- White

Read these instructions before commencing installation & retain them for future reference.

IP55  **240V**
(from the front only)

These Sensors are Class II and do not require an Earth connection

Important Information

It is recommended that luminaires are installed and fitted by a qualified electrician ensuring the installation complies with current IEE wiring regulations & local building control. These products are designed for connection to a 220~240V 50/60Hz supply. Any broken or damaged parts should be replaced as soon as possible. KSR will not accept responsibility for any claims arising from a poor installation.

Installation Guidelines

Remove the terminal cover, cord grip and keep safe.
Ensure a suitable location for the sensor with adequate void, avoiding:
Highly reflective surfaces, sources of heat, air conditioning units, lamps, objects that may move in the wind, etc that could cause unwanted triggering.
Cut out of 64mm hole.

Terminate your mains input cable into the L & N terminals, then connect the luminaire wires into the L' & N' terminals on the sensor. Earth provision is provided if required.
Replace the terminal cover and cord grip, set the required time and lux settings and install into the ceiling void ensuring the seal is in place.

On initial installation it is advised you leave the time setting to 10 Seconds and the Lux setting on the 'sun' symbol. This will allow you to test and set up the sensor as required.



Time - This sensor can switch the lighting from a minimum of 10 Seconds to a maximum of 15 minutes, carefully turn the time dial to the required time.

Lux - This sensor will activate between daylight and 3 Lux, in order to achieve the required 'on' time it is recommended that the sensor is set to 30 Lux and wait 24 hours, after this period you can adjust the Lux control to up or down accordingly.



Position - Ensure you position the sensor in a location suited to the the required activation point, this may not be central to any space.

PIR Specification:

Mains Input - 220~240VAC 50/60Hz
Lux Control - <3-2000 Lux Adjustable
Time Setting - Min 10 Seconds +/- 3 Second
 Max 15 Minutes +/- 2 Minutes
Rated Load - LED 600W
 Halogen 1200W
Detection Area - 360°
Detection Distance - 8m Max (<24°C)
Parasitic Power - 0.5W
Installation Height - 2.2m~4m
Detection Speed: 0.6~1.5m/s
Working Temperature: -20~+40°C

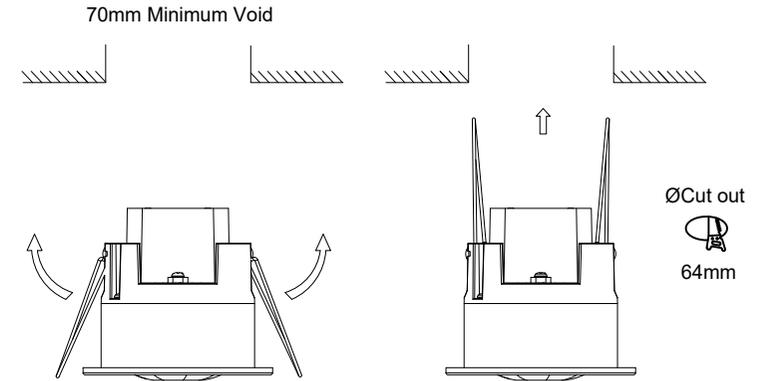

Manual Override
To manually override the sensor switch the wall switch OFF-ON, OFF-ON within 3 seconds.
This will override the sensor for 8 hours it will revert back to automatic control.
If you wish to revert back manually before the 8 hours switch off then switch on after 0.3sec

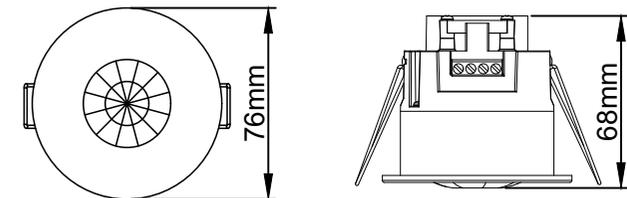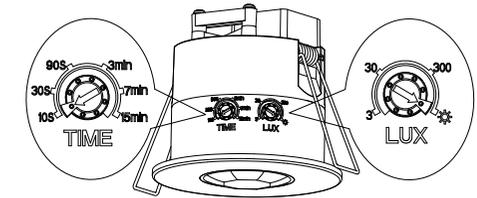

KSR Lighting Aftersales: 023 92 674343
E-mail: aftersales@ksrlighting.com